


Rev.	Amendments	Date	Made By	Chk'd By

NOTE

All cable glands are to be fitted with brass locknuts.
 Earth tags are to be fitted to each gland on the inside of the consumer unit with each tag connected individually to the consumer unit earth terminal block.

Stainless Steel Consumer Unit with 100 Amp Double Pole Switch and BS1361 Fuse Carriers with a Minimum of 25% Spare Ways. (Insert Fuse Rating Required) either 8 Way, 12 Way or 18 Way.

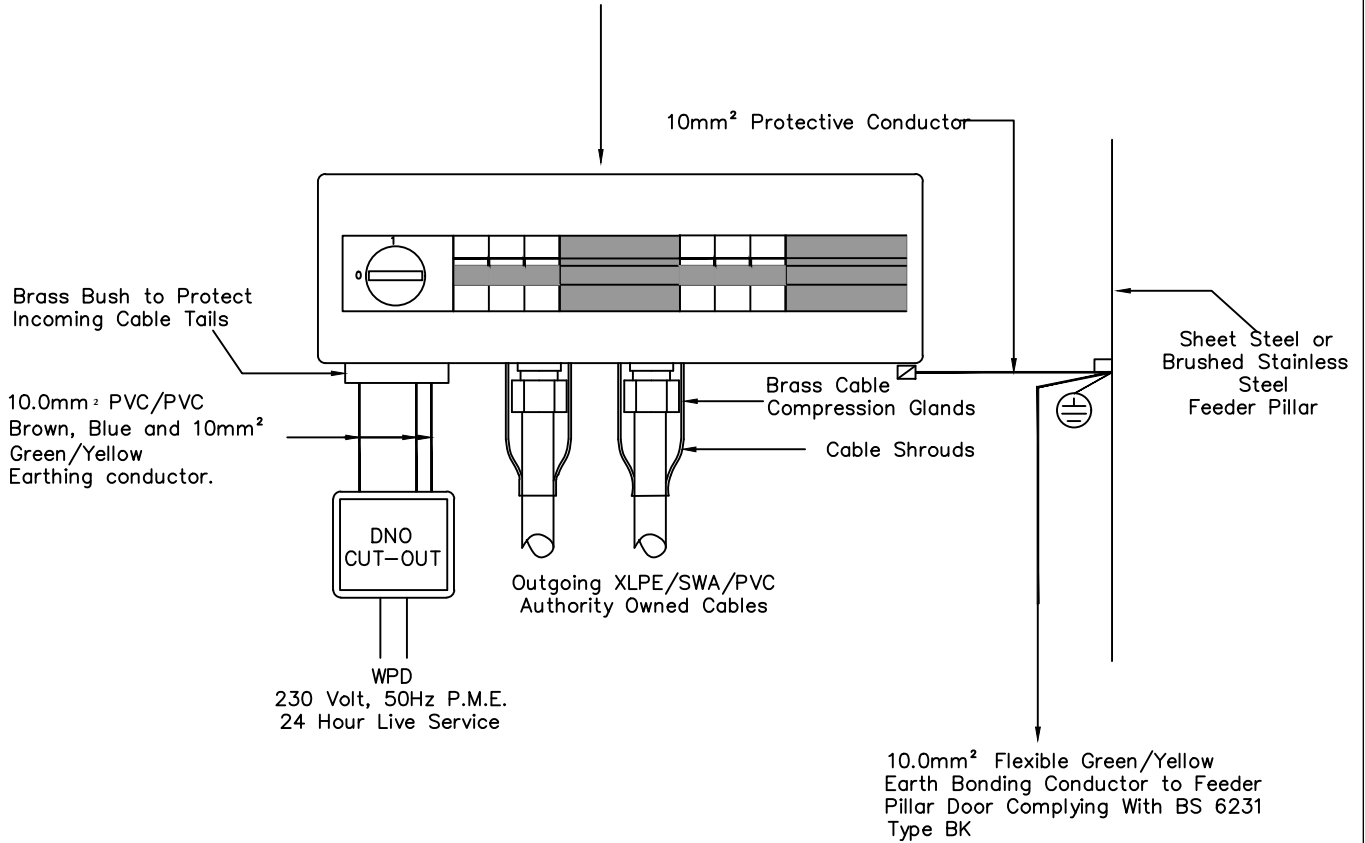

NOTE

The size and rating of the Mains Tails + Earth Conductor is relevant to the size and rating of the largest outgoing XLPE/SWA/PVC Authority owned cable

STREET LIGHTING FEEDER PILLAR GENERAL ARRANGEMENT

COMMON STANDARDS FOR WALES
 HIGHWAY DESIGN GUIDE

Drawn	MT
Checked	SZ
Date	Feb '20
Scale	N.T.S.
Drg. No.	712
Rev.	